
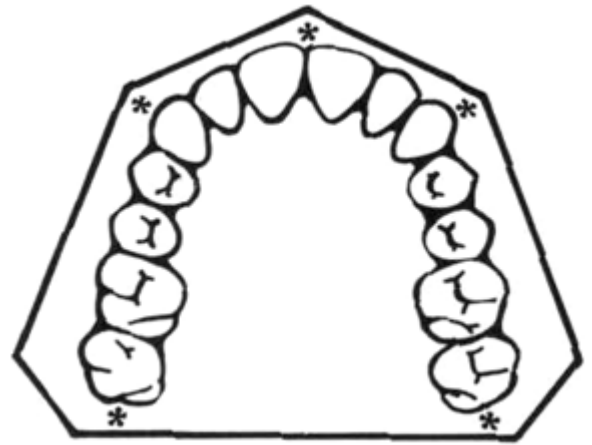
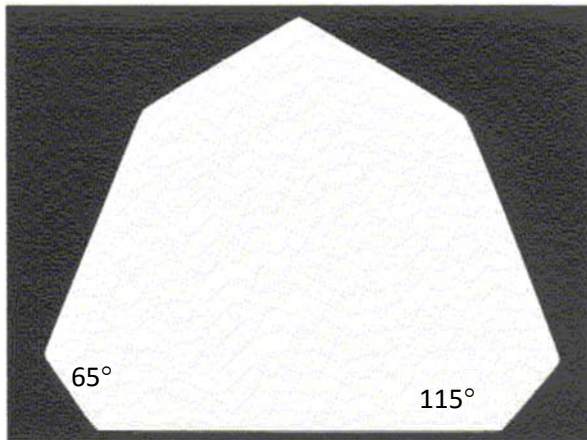
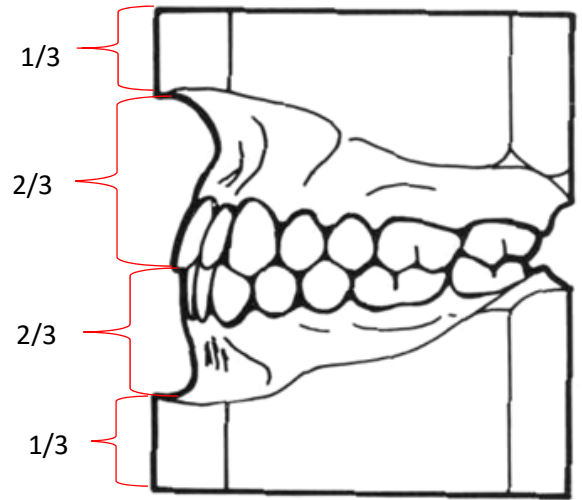


**DENTAL CAST GUIDELINES**



Bases apply only to physical models. Do not include bases on digital models.

The Board seeks symmetry in model base trimming. A five degree tolerance in base angles is acceptable.

Occlusion for physical models is determined by placing the separated, properly trimmed study casts on a flat surface and then bringing them together into maximum intercuspation.

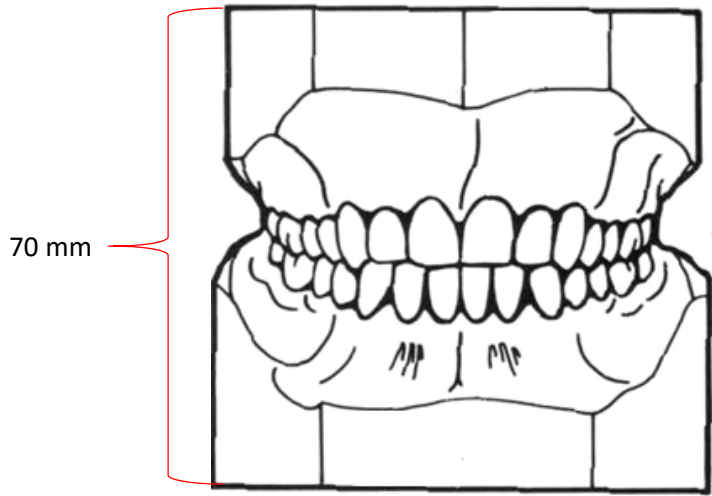

Maxilla

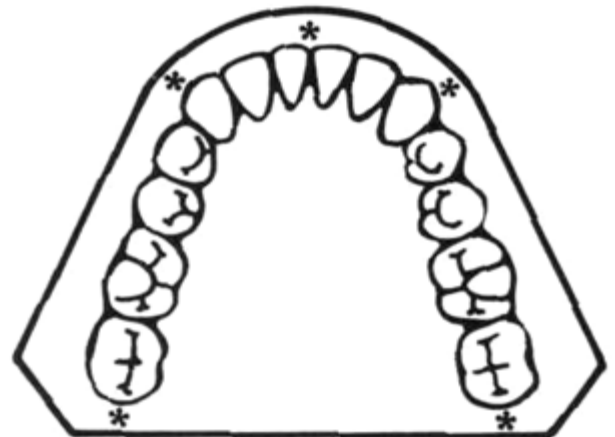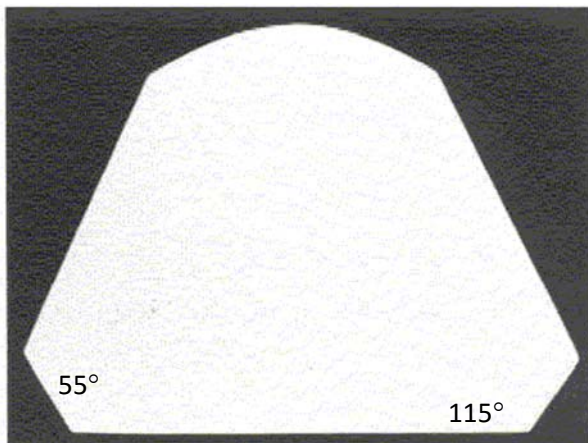

Mandible